
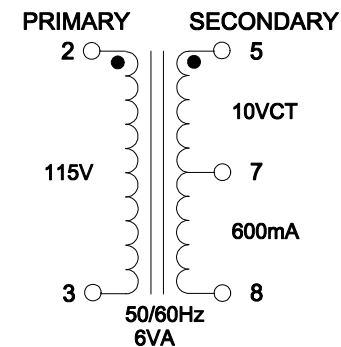


DIMENSIONS:

A	2.375" ± 0.063
B	1.300" ± 0.125
C	1.433" ± 0.063
D	2.000" ± 0.063
E	1.659" ± 0.063
G	0.187" ± 0.015

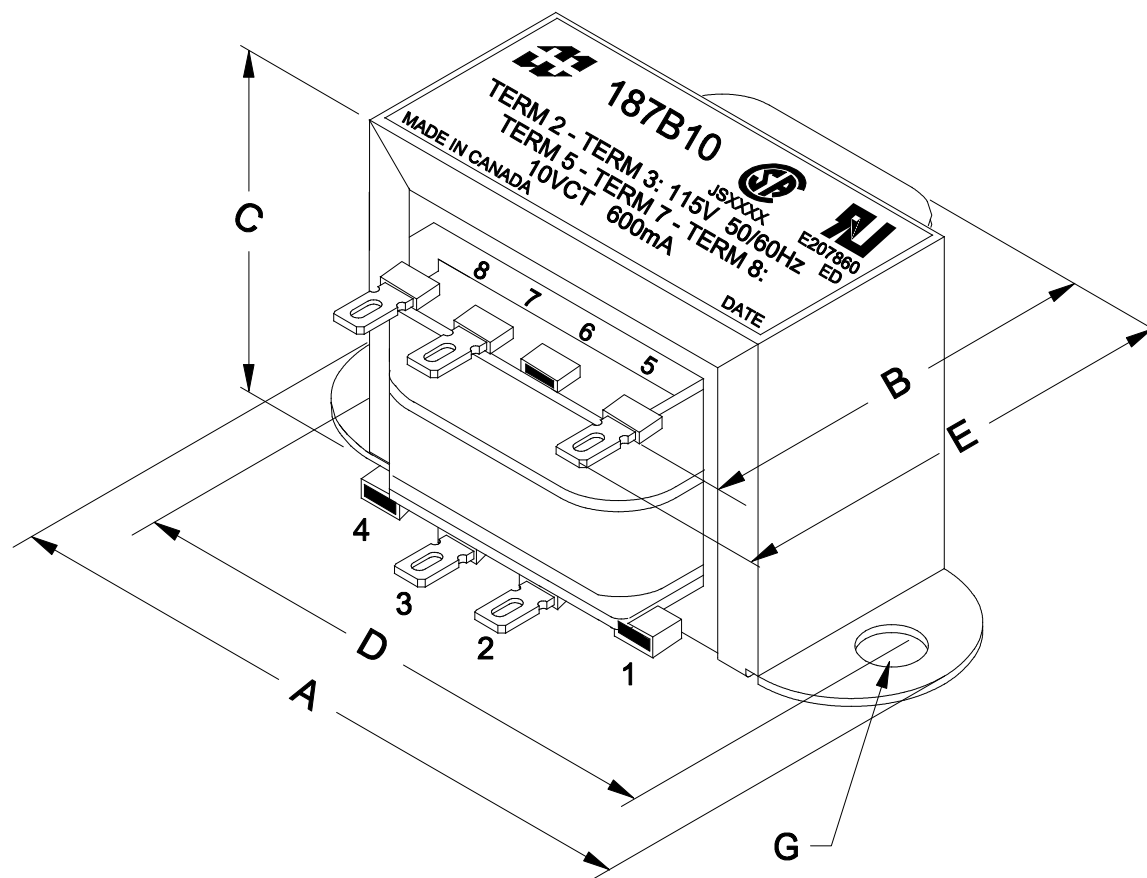

ELECTRICAL DATA:

TESTS	CONDITIONS	ACCEPTANCE CRITERIA
I _{ex}	@ 115V, 60Hz, TERM 2 - TERM 3	37.2mA Max.
Sec. N.L.V	@ 115V, 60Hz, TERM 2 - TERM 3	
	TERM 5 - TERM 8 =	12.80V $\pm 2\%$
	TERM 5 - TERM 7 = TERM 7 - TERM 8 =	6.399V $\pm 2\%$
DCR	@ 20°C, TERM 2 - TERM 3 =	158.6 Ω $\pm 20\%$
	@ 20°C, TERM 5 - TERM 8 =	1.720 Ω $\pm 20\%$
HIPOT	PRIMARY - SECONDARY	2500V, 60Hz, 1 SEC

REV.#	REVISION	DATE	HAMMOND ELECTRONIC DIVISION			
0	RELEASED.	C.I. 05/18/23	52 RANKIN PLACE, WATERLOO, ONTARIO, N2J 3Z5			
			PH # (519) 886-6181			
			FAX # (519) 886-9540			
			DWG. BY: C. ILIE	CHK'D BY:	TITLE: POWER TRANSFORMER	DWG. NO. 187B10
			DATE: 05/18/23	APP'D. BY:		
				DIMENSIONS: IN(X) MM()		